



# CITY OF CAMILLA

30 East Broad Street  
Post Office Box 328  
Camilla, Georgia 31730  
Phone 229-336-2220 Fax 229-336-2224  
[www.camillaga.net](http://www.camillaga.net)



## ADVERTISEMENT FOR BIDS

CITY OF CAMILLA, GEORGIA

### THREE PHASE PADMOUNT TRANSFORMER

Sealed bids for the purchase of a new or reconditioned Three Phase Padmount Transformer will be received by the City of Camilla, Georgia at Camilla City Hall – 30 East Broad Street, Camilla, Georgia 31730 until 3:00 P.M. local time on March 19, 2019, at which time the Bids received will be publicly opened and read. The project consists of a new or reconditioned Three Phase Padmount Transformer as shown on attached Project #03192019 with transformer specifications identified. Bidders may provide pricing on new, reconditioned, or both.

Bids will be received for a single prime Contract and bid will contain the following information:

- Issuer, address, representative name, phone, and email
- New or Reconditioned Three Phase Padmount Transformer
- Warranty
- Expected delivery date
- Price

All questions shall be directed to Interim Electric Superintendent Joey Beall, phone (229) 521-0144.

Sealed bid document shall be clearly identified as Three Phase Padmount Transformer and either mailed or delivered to the following address no later than 3:00 P.M. on Tuesday, March 19, 2019:

CITY OF CAMILLA  
30 East Broad Street  
P.O. Box 328  
Camilla, Georgia 31730

\*\*\*\*\* END OF ADVERTISEMENT \*\*\*\*\*

Date of Bid Issue: February 28, 2019

CUSTOMER: Camilla Electric, Camilla, GA

THREE PHASE PADMOUNT TRANSFORMER

KVA: 1000

PRIMARY VOLTAGE: 12470GrdY/7200

SECONDARY VOLTAGE: 480Y/277

PRIMARY TAPS: 2-2.5% FCAN & BN




GALLONS OF FLUID: 354

APPROXIMATE WEIGHT: 8439 Lbs.

IC# 118211827

PURCHASE ORDER # :

PROJECT: 03192019

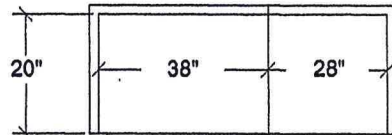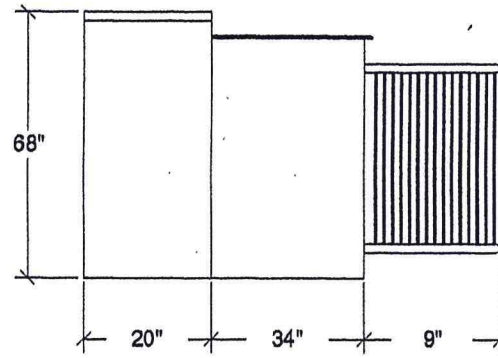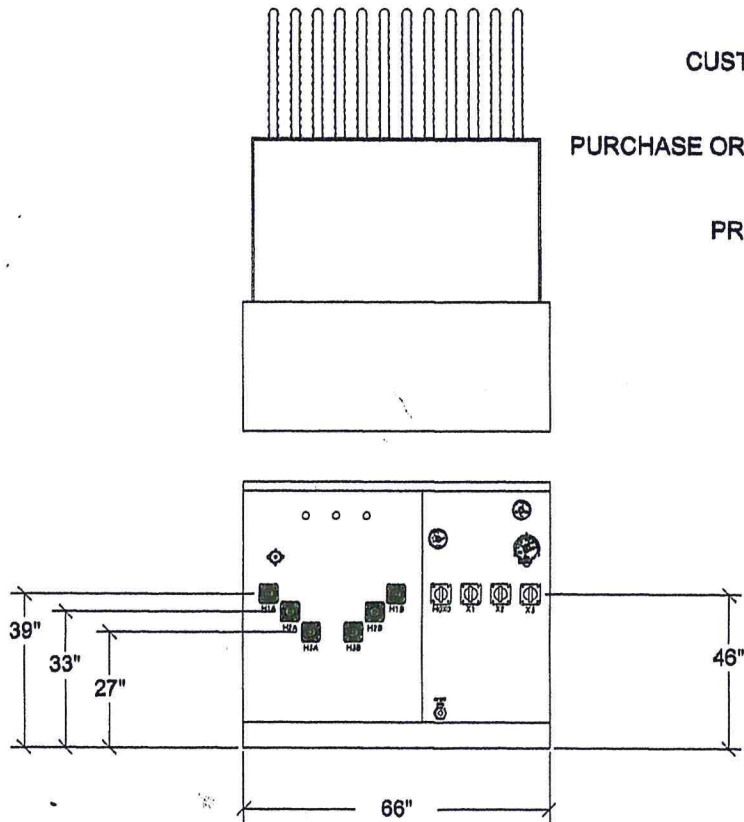

BOTTOM CABINET DETAIL  
SHOWN FROM BELOW

NOTE:

1. ALL DIMENSIONS & WEIGHTS ARE APPROXIMATE.  
THE NUMBER AND PRECISE LOCATION OF GAUGES, VALVES  
PRESSURE RELIEF'S, BUSHINGS AND OTHER COMPONENTS  
SUBJECT TO CHANGE BEFORE UNIT IS COMPLETE.